

Evidence of Performance

Airborne sound insulation of building elements

Test report 163 38760/2e

This is a translation of the test report 163 38760/2 of 19th June 2009.




Client **Press Glas S.A.**
Nowa Wies
Kopalniana 9

42-262 Poczesna
Poland

Basis

EN ISO 140-1:1997+A1:2004
EN 20140-3 :1995+A1:2004
EN ISO 717-1 : 1996+A1:2006

Representation

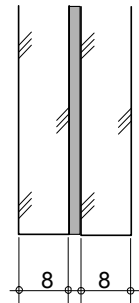

Informations for use

This test report may be used to validate the sound insulation of a building element.

Validity for germany:

R_w corresponds to $R_{w,P}$ for DIN 4109 Annex 1 table 40 a

Product	Laminated glass
Designation	88.2 kl. P2A
Size (w × h)	1230 mm × 1480 mm
Construction	16 mm LSG
Area related weight	40 kg/m ²
Special items	-/-

Validity

The data and results given relate solely to the described, tested object.

Testing the acoustic properties does not allow any statement to be made on further characteristics of the present structure which could define performance and quality.

Weighted sound reduction index R_w
Spectrum adaptation terms C and C_{tr}



$$R_w (C; C_{tr}) = 39 (-1; -3) \text{ dB}$$

Notes on publication

The **ift** Guidance Sheet "Conditions and Guidance for the use of **ift** Test Documents" applies.

The cover sheet can be used as a summary.

Contents

This test report includes 6 pages

- 1 Test specimen
 - 2 Test procedure
 - 3 Test results
 - 4 Instructions for use
- Data sheet (1 page)

ift Rosenheim
01 July 2009

J. Hessinger

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
ift Centre for Acoustics

Bernd Saß

Bernd Saß, Dipl.-Ing. (FH)
Assistant Head of Testing Department
ift Centre for Acoustics

