

Evidence of performance

Airborne sound insulation of building elements

Test report
No. 13-001137-PR02
(PB 2-H01-04-en-01)




Client **PRESS GLASS SA**
Nowa Wies
Kopalniana 9
42-262 Poczesna
Poland

Basis

EN ISO 10140-1 : 2010
+A1:2012
EN ISO 10140-2 : 2010
EN ISO 717-1 : 1996+A1:2006
Test report no.13-001137-PR02
(PB 2-H01-04-de-01) dated
04 July 2013.

Product	Insulating glass unit
Designation	FL 6/20/55.2 kl.P2A Ar
Overall dimensions (W x H)	1,230 mm x 1,480 mm
Configuration	10 LSG/20/6
Gas filling	Argon , Volume 98 %
Area related mass	40,5 kg/m ²
Special features	-/-

Representation

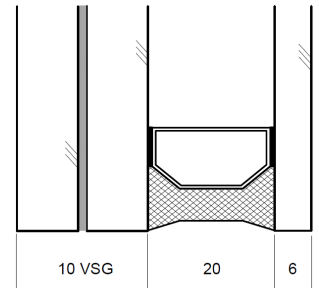

Instructions for use

This test report serves to demonstrate the airborne sound insulation of a building element.
Applicable for Germany
 R_w corresponds to $R_{w,F}$ for DIN 4109 Annex 1 Table 40

Weighted sound reduction index R_w
Spectrum adaptation terms C and C_{tr}



$$R_w (C; C_{tr}) = 41 (-1;-5) \text{ dB}$$

ift Rosenheim
04.07.2013

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Physics

Till Stübgen, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Validity

The data and results given relate solely to the tested and described specimen.

Testing the sound insulation does not allow any statement to be made on further characteristics of the present construction regarding performance and quality.

Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies. The cover sheet can be used as abstract.

Contents

The test report contains a total of 7 pages:

- 1 Object
 - 2 Procedure
 - 3 Detailed results
 - 4 Instructions for use
- Data sheet (1 page)